


PROFILE VIEW

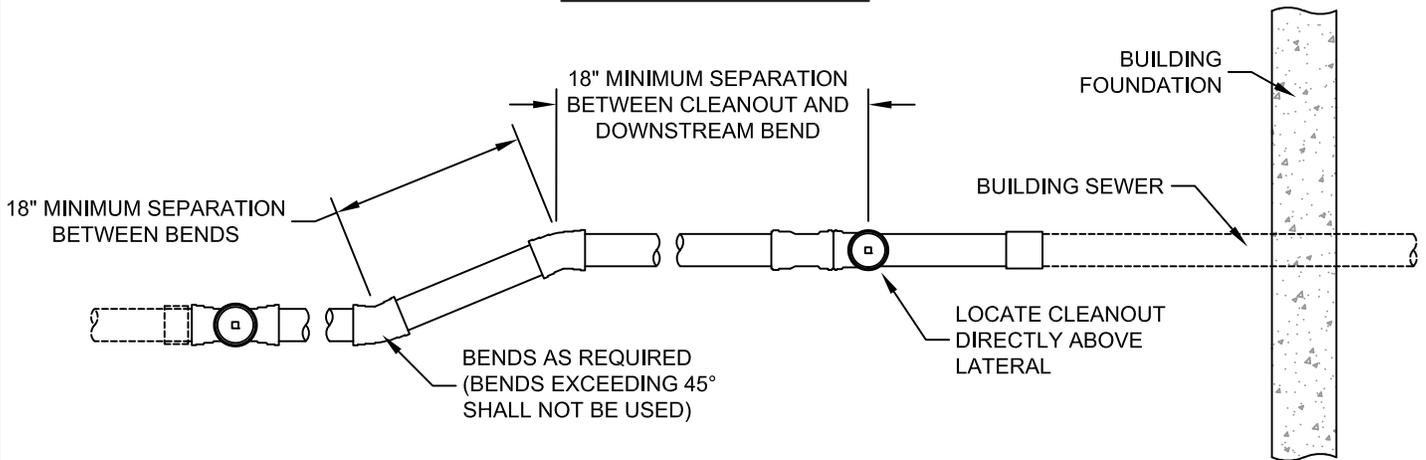

PLAN VIEW

NOTES:

1. CLEANOUTS ARE REQUIRED ON PRIVATE LATERALS AT THE FOLLOWING LOCATIONS:
 - A: WITHIN 5 FEET OF THE BUILDING FOUNDATION
 - B: AT NO MORE THAN 100 FEET APART, MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT
2. BENDS EXCEEDING 45° SHALL NOT BE USED
3. FUSION WELD OR SOLVENT WELD FITTINGS AND JOINTS REQUIRED ON VERTICAL BENDS AND ON SLOPES GREATER THAN 3:1 (33%)
4. MAINTAIN 10' MINIMUM SEPARATION BETWEEN LATERAL AND ANY ADJACENT WATER MAIN LINE OR LATERAL.

